

Memo No:- 2231

Date:- 08/05/2024

Subject : Physical / Chemical Examination Report of Water Sample

Sample ID/Classification : KNL/01863/5/2024 / Private	Sample Details	Date & Time
Sender : Principal, Baba Ram Das Vidyapeeth 31142	Collected By	SCHOOL STAFF
Location : , Kulvehri, Karnal Haryana	Collection Date	07/05/2024 at 11:35
Sample Description : Drinking Water	Received at lab	07/05/2024 at 11:38
Latitude / Longitude : 76.978238 / 29.687754	Analysis Start Date	07/05/2024
	Analysis End Date	08/05/2024
	Sample Quantity	1000ML

Test Result (As Per BIS 10500 :2012)

S.No.	Tested Parameter	Result	Requirement (Acceptable Limit)	Permissible Lmt. (In the Absence of Alternate Source)	Protocol Used
1	Total Dissolved Solids @ 180°C ± 2°C	482	500 mg/lt.	2000 mg/lt.	IS 3025 (Part-16) : 2023
2	Total Hardness as CaCO ₃	240	200 mg/lt.	600 mg/lt.	IS 3025 (Part-21) : 2009 (RA 2023)
3	Calcium as Ca	56	75 mg/lt.	200 mg/lt.	IS 3025 (Part-40) : 1991 (RA 2023)
4	Magnesium as Mg	24	30 mg/lt.	100 mg/lt.	IS 3025 (Part-46) : 2023
5	Iron as Fe	0.01	1.0 mg/lt.	1.0 mg/lt.	USEPA-8008:2017
6	Chloride as Cl	44	250 mg/lt.	1000 mg/lt.	IS 3025 (Part-32) : 1988 (RA 2019)
7	Sulphate as SO ₄	55	200 mg/lt.	400 mg/lt.	USEPA-8051:2017
8	Fluoride as F	0.280	1.0 mg/lt.	1.5 mg/lt.	APHA 24th Edition-4500F C
9	Nitrate as NO ₃	2.6	45 mg/lt.	45 mg/lt.	APHA 24th Edition -4500 NO ₃ D
10	pH @ 25°C	7.65	6.5 - 8.5	6.5 - 8.5	IS 3025 (Part-11) : 2022
11	Total Alkalinity	260	200 mg/lt.	600 mg/lt.	IS 3025 (Part-23) : 1986 (RA 2019)
12	Color	<5	5 Hazen Units	15 Hazen Units	IS 3025 (Part 4): 2021
13	Odour	Agreeable	Agreeable	Agreeable	IS 3025 (Part-5) :1984 (RA 2018)
14	Taste	Agreeable	Agreeable	Agreeable	IS 3025 (Part-8) :1984 (RA 2022)
15	Turbidity	<1	1 NTU	5 NTU	IS 3025 (Part-10):1984 (RA 2022)


Remarks :-

- * The Results Given above are related to the sample as received and tested in PHED KARNAL Lab.
- * The test report can't be regenerated in whole or part there of without written permission of Competent Authority.
- * The test report can't be used for any publicity or any legal purpose.
- * Reliability of water sample sample lies with sender/collector of water sample.
- * To check the sample report online Scan the QR Code below.
- * The test samples meant for chemical analysis will be disposed off after 7 days from the data of issue of test report unless until specifically requested by the customer for retaining over a longer period.

Water Sample has been found **"CONFORMING"** to Limits set in BIS10500:2012 for the tested parameters.



Jaginder Singh
Sample analyzed by

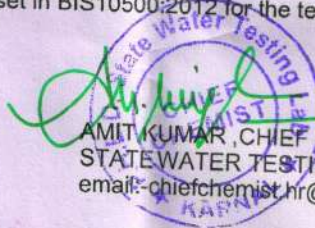

AMIT KUMAR, CHIEF CHEMIST
STATE WATER TESTING LABORATORY, KARNAL
email: chiefchemist.hr@phedharyana.gov.in